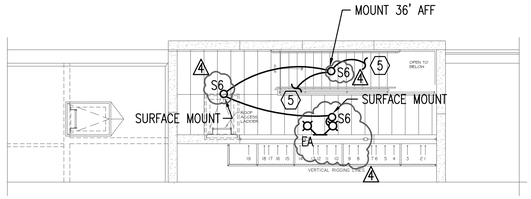

KEYED NOTES:

1. EXISTING LIGHT FIXTURE TO REMAIN.
2. ROUTE (2) #10 & #10 GRD. TO DIMMER RACK FOR CONTROL OF LIGHTS. VERIFY WHICH DIMMER WILL CONTROL THIS CIRCUIT PRIOR TO INSTALLATION.
3. SEE SHEET E3.1 FOR CONTINUATION.
4. SEE PLAN B THIS SHEET FOR CONTINUATION.
5. SEE PLAN A THIS SHEET FOR CONTINUATION.
6. DOWN TO SWITCH 'f'. SEE SHEET E2.0.
7. ROUTE (2) #10 & #10 GRD. TO NON-DIM CIRCUIT IN DIMMER RACK.
8. ROUTE (2) #10 & #10 GRD. TO CONSTANT CIRCUIT MODULE IN DIMMER RACK. "HE" FIXTURES SHALL ONLY ILLUMINATE IN AN EMERGENCY AND SHALL NOT BE SWITCHED.

PLAN NOTES:

1. BRANCH CIRCUITS ARE INDICATED AS ONE CIRCUIT HOME RUNS WITH INDIVIDUAL NEUTRALS. CONTRACTOR MAY GROUP SINGLE POLE BRANCH CIRCUITS IN MULTIPLE CIRCUIT HOME RUNS WITH A SHARED NEUTRAL (3 CIRCUITS MAXIMUM). SUCH GROUPED CIRCUITS ARE THEN MULTIWIRE BRANCH CIRCUITS. INSTALLATION OF MULTIWIRE BRANCH CIRCUITS SHALL COMPLY WITH ALL N.E.C. MULTIWIRE BRANCH CIRCUIT REQUIREMENTS, INCLUDING A SINGLE DISCONNECTING MEANS PER N.E.C. ARTICLE 210, PARAGRAPH 210.4(B).
2. ALL PENETRATIONS IN THE RATED WALLS AND CEILINGS SHALL BE SEALED WITH A MATERIAL CAPABLE OF PREVENTING THE PASSAGE OF FLAMES AND HOT GASSES. THE SEALANT SHALL HAVE A T-RATING OF ONE HOUR.
3. ALL PIPING, CONDUIT, AND OUTLET BOXES (ELECTRIC, TELEPHONE, COMPUTER, ETC.) IN THE RATED WALLS OR CEILING SHALL BE CONSTRUCTED OF NON-COMBUSTIBLE MATERIAL.
4. REFER TO ARCHITECTURAL REFLECTED CEILING PLANS FOR EXACT LIGHT FIXTURE LOCATIONS. VERIFY ALL DISCREPANCIES WITH ARCHITECT PRIOR TO ROUGH-IN.

B ELECTRICAL LIGHTING PLAN - LOADING BRIDGE STAIR

SCALE: 1/8" = 1'-0"

A ELECTRICAL LIGHTING PLAN - UPPER LEVEL

SCALE: 1/8" = 1'-0"

MOUNT 'S6', 'S7', AND 'S8' FIXTURES EVEN WITH THE BOTTOM OF THE CLOUDS.

NOTE: ALL CEILINGS ARE FIRE RATED EXCEPT FOR AUDITORIUM. REFER TO ARCHITECTURAL PLANS. TENT LIGHT FIXTURES ACCORDINGLY.

KEY PLAN

HANNEY & ASSOCIATES, ARCHITECTS
1726 South Hillside, Wichita, Kansas, 67211
Phone (316) 683-8965
Fax (316) 684-1441
www.haarchitects.com

2009
ANDALE HIGH SCHOOL
ANDALE, KANSAS
RENWICK UNIFIED SCHOOL DISTRICT 267

DRAWINGS ISSUED		
NO.	DATE	ITEM ISSUED
5	2/28	ISSUED FOR BIDS
4	2/24	REVIEW
3	2/12	REVIEW
2	2/05	REVIEW
1	1/30	REVIEW

COMPUTER DRAWING

DATE: FEBRUARY 2009	
DRAWN BY:	CHECKED BY:
JLM	DLD

SHEET
E3.2
OF 16 SHEETS

Professional Engineering Consultants, P.A.
300 W. DOUGLAS, WICHITA, KANSAS 67202 316.262.2691 • FAX 316.262.8003
www.pec1.com

Saved 03-25-2009 6:52:26 AM by JLL
Plot Scale 1:96 03-25-2009 8:11:52 AM by JLL
E:\2008\08004\001\08004-001-E3.2-ELECTRICAL LIGHTING PLAN UPPER