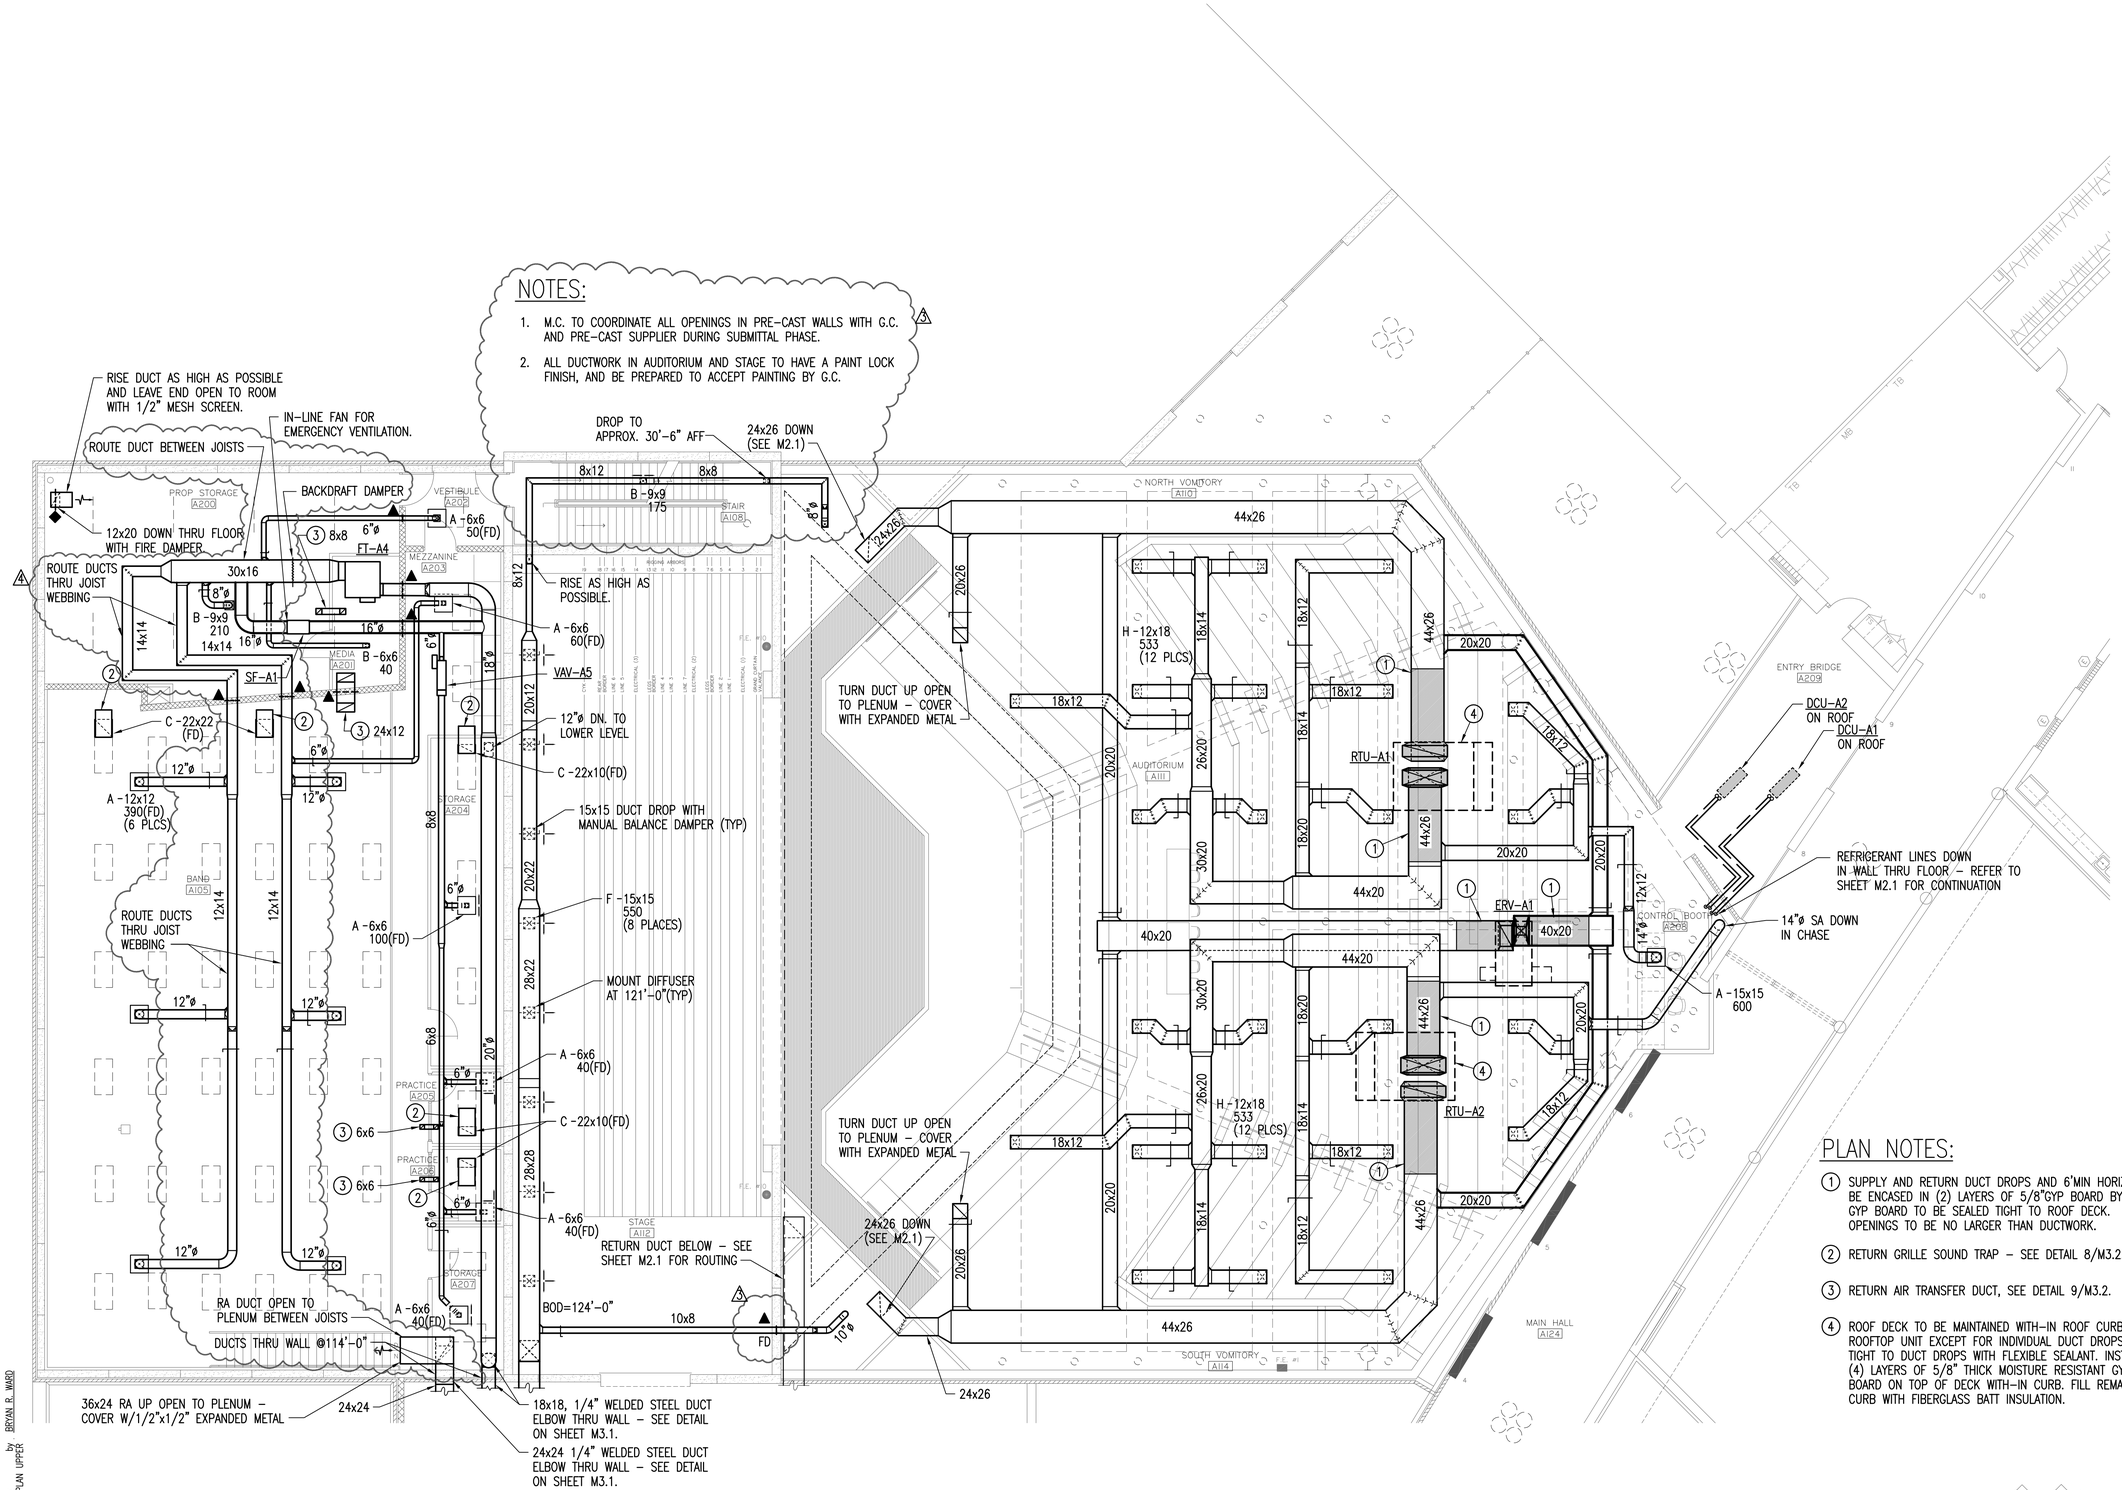

PLAN NOTES:

1. SUPPLY AND RETURN DUCT DROPS AND 6'MIN HORIZONTAL TO BE ENCASED IN (2) LAYERS OF 5/8"GYP BOARD BY THE GC. GYP BOARD TO BE SEALED TIGHT TO ROOF DECK. ROOF OPENINGS TO BE NO LARGER THAN DUCTWORK.
2. RETURN GRILLE SOUND TRAP - SEE DETAIL 8/M3.2.
3. RETURN AIR TRANSFER DUCT, SEE DETAIL 9/M3.2.
4. ROOF DECK TO BE MAINTAINED WITH-IN ROOF CURB BELOW ROOFTOP UNIT EXCEPT FOR INDIVIDUAL DUCT DROPS, SEAL TIGHT TO DUCT DROPS WITH FLEXIBLE SEALANT. INSTALL (4) LAYERS OF 5/8" THICK MOISTURE RESISTANT GYP. BOARD ON TOP OF DECK WITH-IN CURB. FILL REMAINDER OF CURB WITH FIBERGLASS BATT INSULATION.

A **HVAC PLAN - UPPER LEVEL**

SCALE: 1/8" = 1'-0"

KEY PLAN

HANNEY & ASSOCIATES, ARCHITECTS
1726 South Hillside, Wichita, Kansas, 67211
Phone (316) 683-8965
Fax (316) 684-1441
www.haarchitects.com

2009
ANDALE HIGH SCHOOL
ANDALE, KANSAS
RENWICK UNIFIED SCHOOL DISTRICT 267

DRAWINGS ISSUED		
NO.	DATE	ITEM ISSUED
4	3/24	ADDENDUM NO. 4
3	3/24	ADDENDUM NO. 3
5	2/28	ISSUED FOR BIDS
4	2/24	REVIEW
3	2/12	REVIEW
2	2/05	REVIEW
1	1/30	REVIEW

COMPUTER DRAWING

DATE: FEBRUARY 2009
DRAWN BY: CHECKED BY:

SHEET
M2.2
OF SHEETS

Professional Engineering Consultants, P.A.
301 S. Emporia, WICHITA, KANSAS 67202 • 316-262-2691 • FAX 316-262-3003
www.pec1.com

Saved 03-25-2009 7:41:50 AM by BRW
Plot Scale 1:96 03-25-2009 7:43:44 AM by BRYAN R. WARD
M:\2008\08004\001\08004-001-M2.2-HVAC PLAN UPPER